


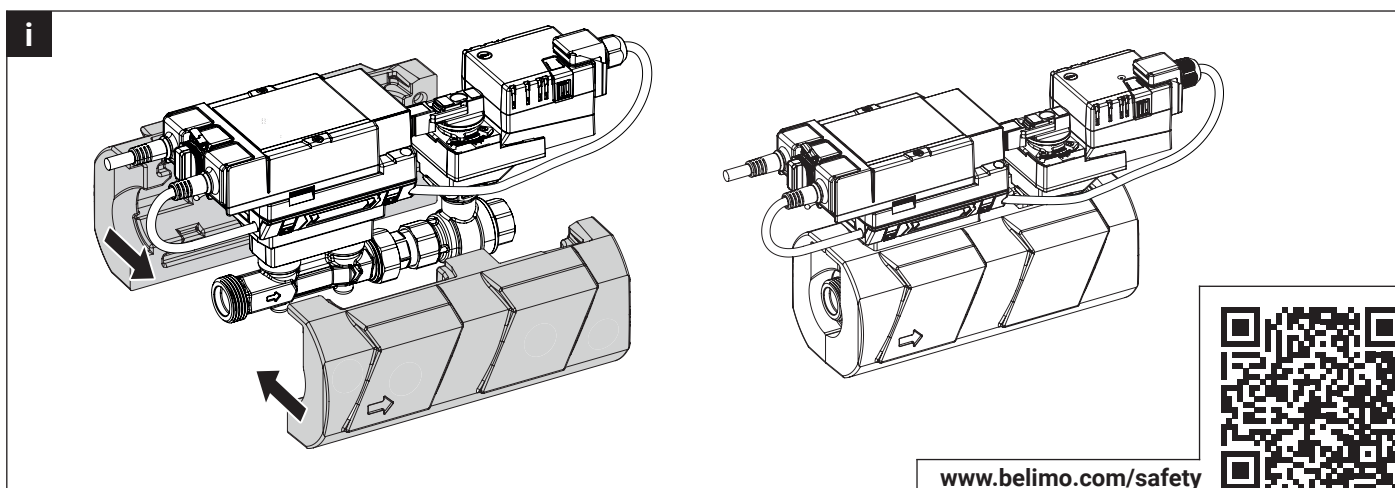
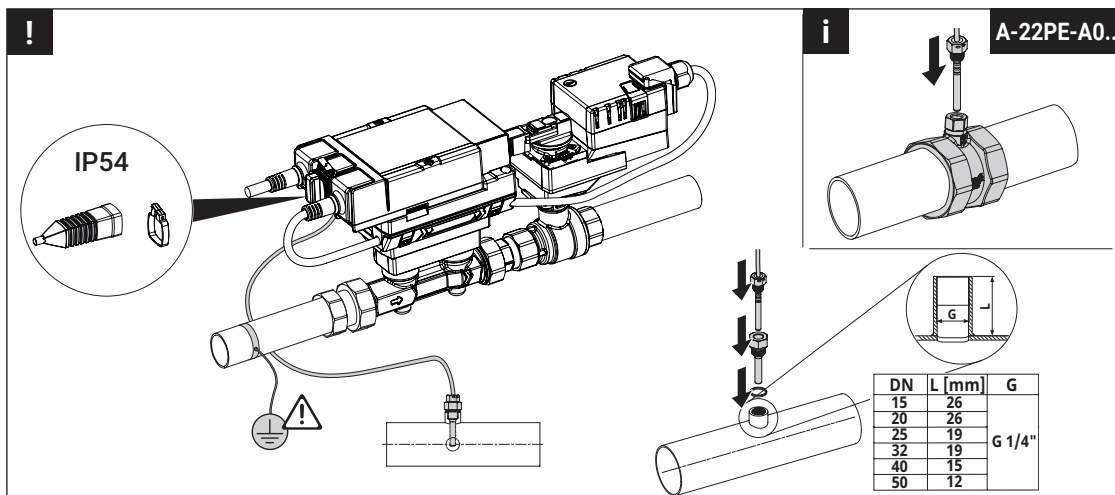
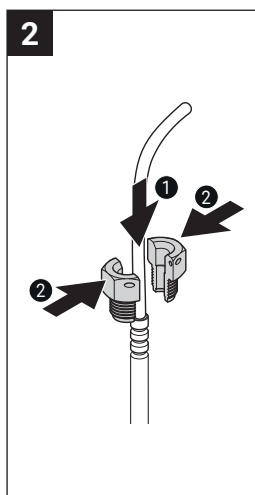
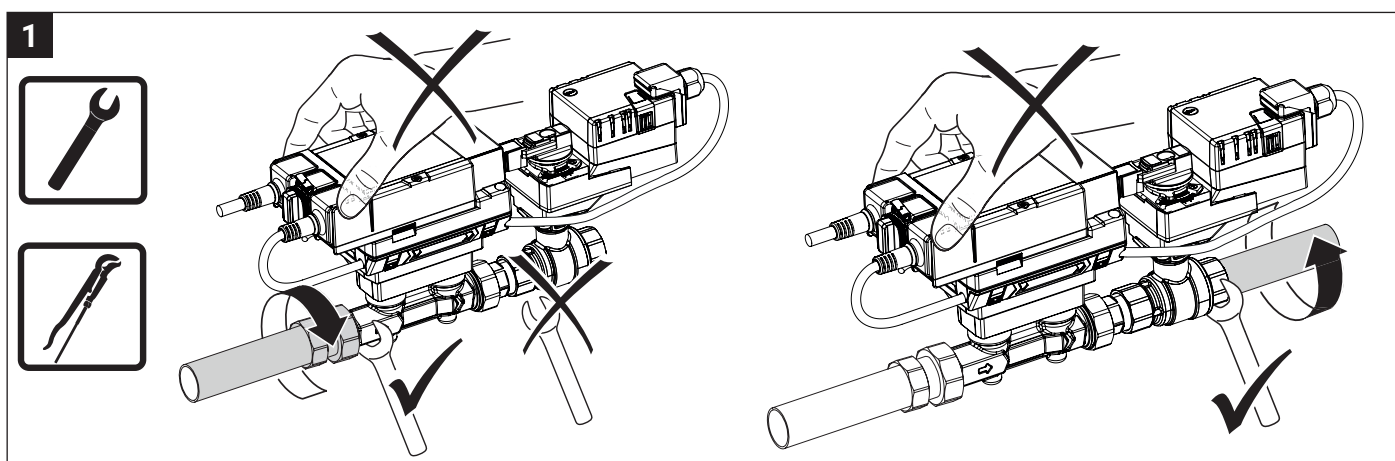


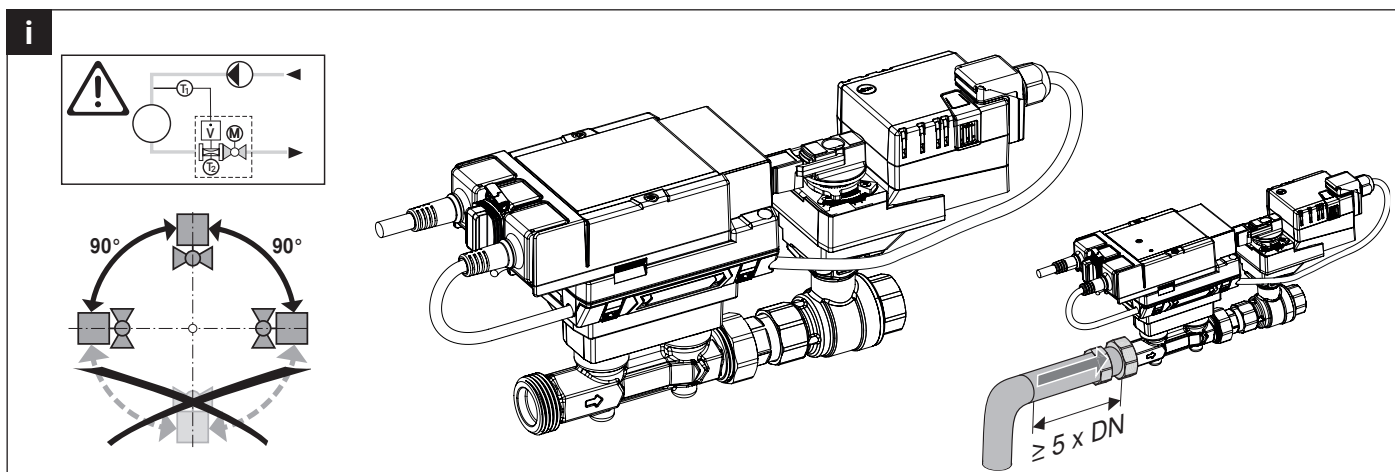


1 = GND
 2 = AC/DC 24 V
 3 = Sensor
 5 = MP, 0...10 V
 6 = C1 = D- = A
 7 = C2 = D+ = B

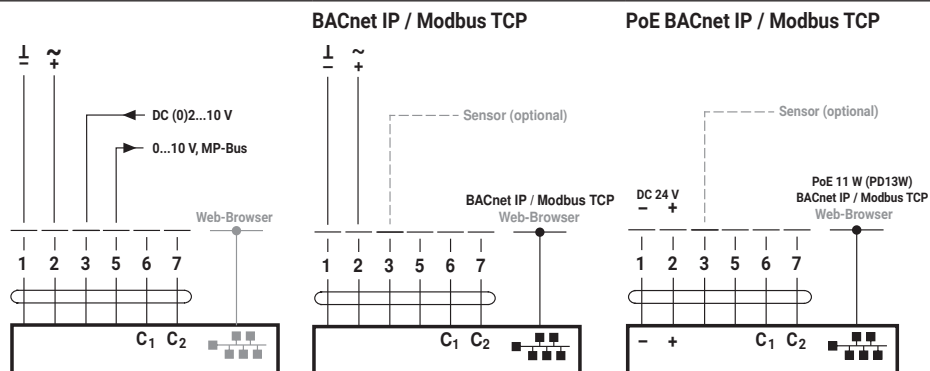


BACnet MSTP / Modbus RTU

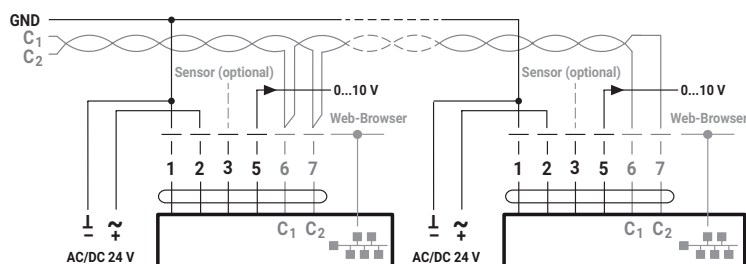





MP-Bus

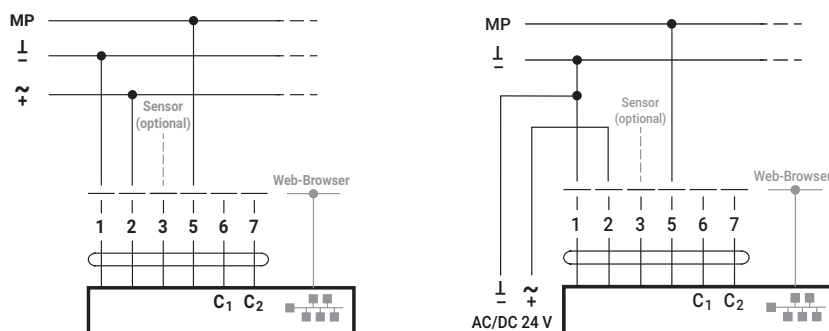

M-Bus

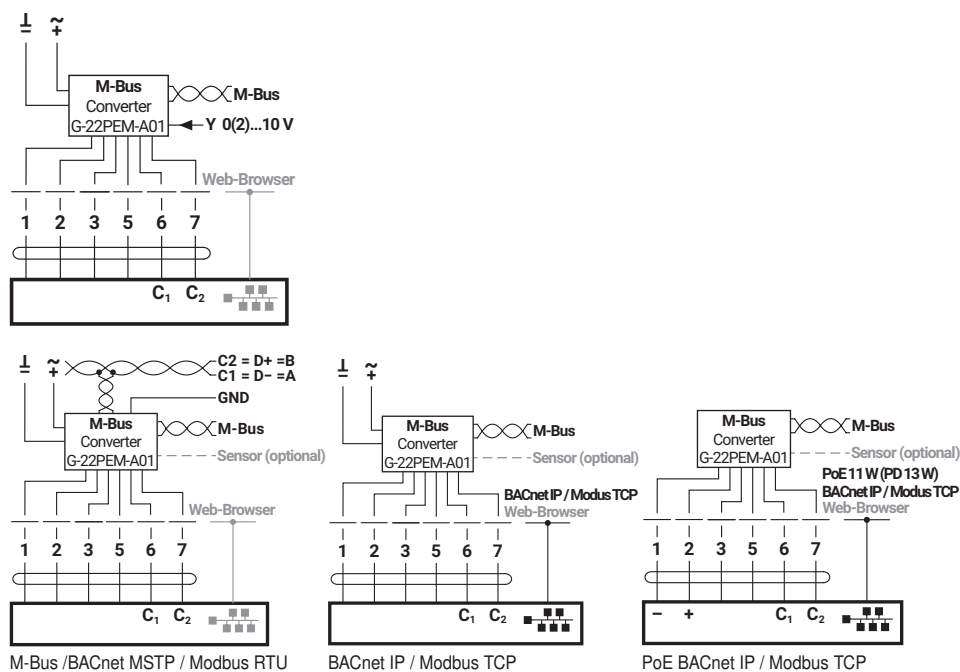

Sensor (optional)

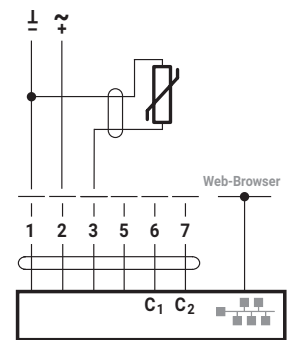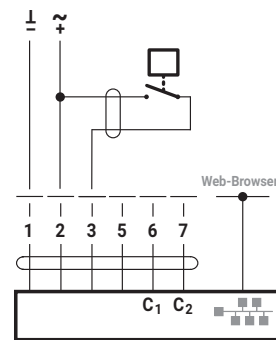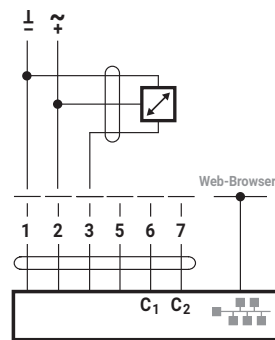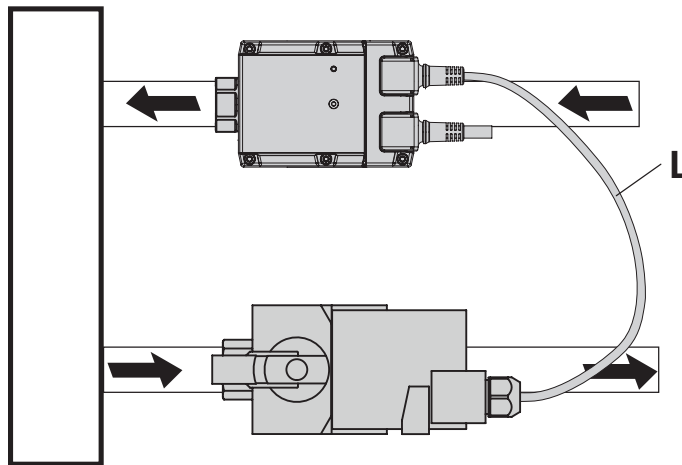
i optional


DN	L [mm]
15...50	750